

PRODUCT INFORMATION BULLETIN

AIR-EAGLE® XLT 900MHz RF Receiver MODEL 441-21600-DC

DESCRIPTION


The AIR-EAGLE XLT is an RF system designed for medium to long range wireless remote control of electrical apparatus in a variety of industrial applications. Systems can consist of any number of receivers and handheld or contact input transmitters working together. This receiver is equipped with 16 independent relays that can switch 5 amps @ 120VAC or 30VDC. The relays are user programmable for momentary or toggle/latching operation and can be directly interfaced with the customer's equipment or P.L.C. Eight user selectable frequencies allow multiple systems to be used in the same area. The Air-Eagle XLT can receive remote signals transmitted from up to 2500 feet away (with a handheld transmitter) or up to 2 miles away (with a stationary transmitter and external antennas).

INSTALLATION

DISCONNECT DC Power from all equipment before installation.

- 1. Mount the AIR-EAGLE XLT RECEIVER in a convenient location.
- 2. Install relay wiring to terminal strip.
- Install antenna onto connector located on the right side on the enclosure.
- 4. Connect supplied power input cable to your external power source.

DIMENSIONS

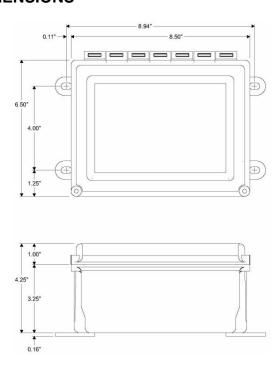



TERMINAL STRIP WIRING

| BOTTOM BOARD | | | | | | |
|--------------|---------------|----|----------------------------|-----------|----|---------------|
| | | | | | | |
| 1 | N/O Relay #1 | 10 | N/O F | Relay #4 | 19 | N/O Relay #7 |
| 2 | C Relay #1 | 11 | C Rel | ay #4 | 20 | C Relay #7 |
| 3 | N/C Relay #1 | 12 | N/C F | Relay #4 | 21 | N/C Relay #7 |
| 4 | N/O Relay #2 | 13 | N/O F | Relay #5 | 22 | N/O Relay #8 |
| 5 | C Relay #2 | 14 | C Rel | ay #5 | 23 | C Relay #8 |
| 6 | N/C Relay #2 | 15 | N/C F | Relay #5 | 24 | N/C Relay #8 |
| 7 | N/O Relay #3 | 16 | N/O F | Relay #6 | | |
| 8 | C Relay #3 | 17 | C Rel | ay #6 | | |
| 9 | N/C Relay #3 | 18 | N/C F | Relay #6 | | |
| TOP BOARD | | | | | | |
| 1 | N/O Relay #9 | 10 | N/O F | Relay #12 | 19 | N/O Relay #15 |
| 2 | C Relay #9 | 11 | C Rel | ay #12 | 20 | C Relay #15 |
| 3 | N/C Relay#9 | 12 | N/C F | Relay #12 | 21 | N/C Relay #15 |
| 4 | N/O Relay #10 | 13 | N/O F | Relay #13 | 22 | N/O Relay #16 |
| 5 | C Relay #10 | 14 | C Rel | ay #13 | 23 | C Relay #16 |
| 6 | N/C Relay #10 | 15 | N/C F | Relay #13 | 24 | N/C Relay #16 |
| 7 | N/O Relay #11 | 16 | N/O Relay #14 | | | |
| 8 | C Relay #11 | 17 | C Relay #14 | | | |
| 9 | N/C Relay #11 | 18 | N/C F | Relay #14 | | |
| DC INPUT | | | | | | |
| Terminal #1 | | | Negative (-) 9-36VDC INPUT | | | |
| Terminal #2 | | | Positive (+) 9-36VDC INPUT | | | |

AIR-EAGLE® XLT 900MHz RF Receiver MODEL 441-21600-DC

SERIES FEATURE

The "441" Series features repeating capability. Transmitters can be set up to send "repeat signal packets", and any transmitter or receiver within its range will repeat the signal packet to help propagate communication over widespread areas.

APPROVALS

| United States (FCC) | MCQ-XB900HP |
|---------------------|---------------|
| Canada (IC) | 1846A-XB900HP |

GENERAL OPERATION

Relays #1 thru #16 energize or de-energize based on specific commands from a handheld or contact input transmitter.

| BUTTON OR INPUT ACTIVATED | RELAY OPERATION |
|---------------------------------|---|
| "1" | Relay #1 energizes, maintained momentary |
| "2" | Relay #2 energizes, maintained momentary |
| "3" | Relay #3 energizes, maintained momentary |
| "4" | Relay #4 energizes, maintained momentary |
| "5" | Relay #5 energizes, maintained momentary |
| "6" | Relay #6 energizes, maintained momentary |
| "7" | Relay #7 energizes, maintained momentary |
| "8" | Relay #8 energizes, maintained momentary |
| "9" | Relay #9 energizes, maintained momentary |
| "10" | Relay #10 energizes, maintained momentary |
| 11" | Relay #11 energizes, maintained momentary |
| "12" | Relay #12 energizes, maintained momentary |
| "13" | Relay #13 energizes, maintained momentary |
| "14" | Relay #14 energizes, maintained momentary |
| "15" | Relay #15 energizes, maintained momentary |
| "16" | Relay #16 energizes, maintained momentary |

SPECIFICATIONS

| DC Input | 9-36VDC @ 10 WATTS | | |
|---|---|--|--|
| Fuse Protected | 1 amp | | |
| Relay Contacts | SPDT 5 amp @ 120VAC or 30VDC per channel | | |
| Receiver Range | Up to 2500 Feet w/Standard Antenna | | |
| Note: Max range figures are estimates, based on free-air terrain with limited sources of interference. Actual range will vary based on transmitting power, orientation of transmitter and receiver, height of transmitting antenna, height of receiving antenna, weather conditions, interference sources in the area, and terrain between receiver and transmitter, including, but not limited to, indoor and outdoor structures such as walls, metal objects, trees, buildings, hills, and mountains. | | | |
| Receiver Frequency | 900 MHz Spread Spectrum | | |
| RF Networks | Eight Independent Frequencies | | |
| Enclosure | Hinged fiberglass with window / NEMA 3, 3R, 4, 12, 13 | | |
| Operating Temp | -40° F to +185° F | | |
| Weight | Approx 3.83 lbs. | | |

RELAY & FREQUENCY SET-UP

This unit is shipped from the factory with SEL1 switches #1 and #2 in the open positions. All sixteen relays will operate in a maintained momentary manner, and unit is receiving commands on frequency one. If you wish to change these default settings, follow the instructions on the table below.

- 1) Remove power from unit
- 2) Remove top cover.
- Select desired relay operation and/or network frequency using table below
- 4) Reattach cover and apply power.
- 5) Programming is now complete.

| RELAY CONFIGURATION | | | | | |
|---|--|---------------------------------|--|--|--|
| SEL1 SWITCH NUMBER | OPEN | CLOSED | | | |
| SW1 | Relays #1 thru #8 maintained momentary (default) | Relays #1 thru #8 toggle/latch | | | |
| SW2 Relays #9 thru #16 maintained momentary (default) | | Relays #9 thru #16 toggle/latch | | | |

<u>Maintained Momentary</u> – Relay mimics button or input – when depressed or closed, relay will be energized; when released, relay deenergizes

<u>Toggle Latch</u> – Relay changes (and holds) its state each time the corresponding button or input is depressed or closed.

| SW3 | Vibrating Feedback OFF (default) | Vibrating Feedback ON |
|-----|----------------------------------|-----------------------|
| SW4 | Not used on this model | |

| FREQUENCY SET-UP | | | | |
|------------------|----------------------|--------|--------|--------|
| | Network Frequency | SW5 | SW6 | SW7 |
| | 1 (default) | OPEN | OPEN | OPEN |
| | 2 | CLOSED | OPEN | OPEN |
| SEL1 | 3 | OPEN | CLOSED | OPEN |
| (SW5-7) | 4 | CLOSED | CLOSED | OPEN |
| | 5 | OPEN | OPEN | CLOSED |
| | 6 | CLOSED | OPEN | CLOSED |
| | 7 | OPEN | CLOSED | CLOSED |
| | 8 | CLOSED | CLOSED | CLOSED |

ACCESSORIES


| Standard Antenna (Included): | | | |
|--|---------|---------|--|
| 900MHz TNC "Rubber Duck" Antenna | 49-1103 | | |
| Mobile/Base Antennas – Used to help achieve max range in both non line of sight and line of sight applications Contact BWI Eagle for recommendations | | | |
| 900MHz Thru-Hole Mount Mobile Antenna | | 49-2101 | |
| 900MHz Magnet Mount Mobile Antenna | 49-2102 | | |
| 900MHz Omni Directional Base Antenna | 49-3101 | | |
| 900MHz Yagi Directional Base Antenna | 49-3102 | | |
| High Quality Coax Cables – Used to connect external high gain antennas to control unit | | | |
| Flex Coax Cable w/Connectors – Available in 5',15',25',30',40',60',80',100' Lengths | | | |
| Bulkhead Extensions – Used to provide an external antenna connection when mounting control unit inside another enclosure | | | |
| TNC Male to TNC Bulkhead Cable Assembly - Available in 2', 4', 7' Lengths 49-5004-X-IS' (X = # of Feet | | | |

DOCUMENT DATE: 07/22/2021 / PRODUCT REV. 5




RELAY OUTPUT WIRING 16-Relay Receiver

Receiver outputs are dry relay contacts, like an SPDT switch. When the relay is in a de-energized state, the N/C (normally closed) contact is connected to C (common). When the relay is energized the N/O (normally open) contact is connected to C (common).



Normally Open Application with Externally Supplied Voltage

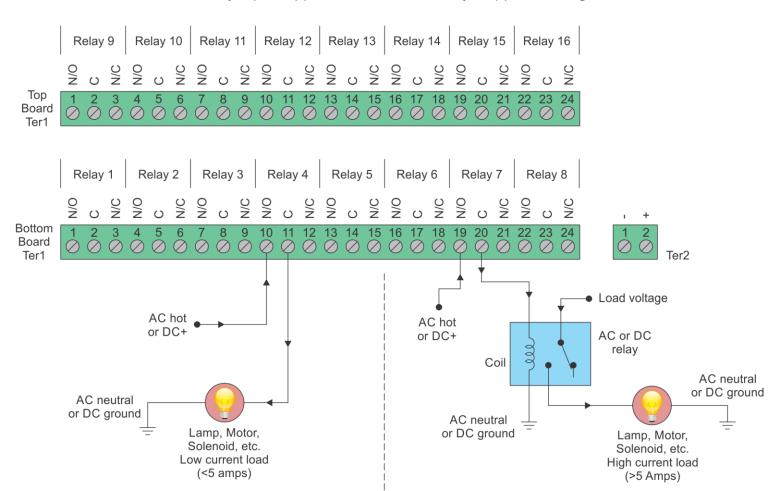

Internal Relay - Loads Less Than 5 Amps

Loads up to 5 Amps may be wired directly to the internal relays. Wiring to the N/O contact will cause the load to turn on when the relay is energized (the load is on when the relay is on). Wiring to the N/C contact will cause the load to turn on when the relay is de-energized (the load is on when the relay is off). AC or DC voltages can be switched through the relay.

External Relay - Loads Over 5 Amps

Loads over 5 Amps must use an external high current relay. Diagram shows how to turn on the relay using the lower current internal relay of the receiver. AC or DC voltages can be switched through the relay.

Note: A protection diode for DC coils or an MOV for AC coils is recommended to reduce inductive EMI noise.